



MORENO VALLEY STANDARD NO. MVEU-709-0

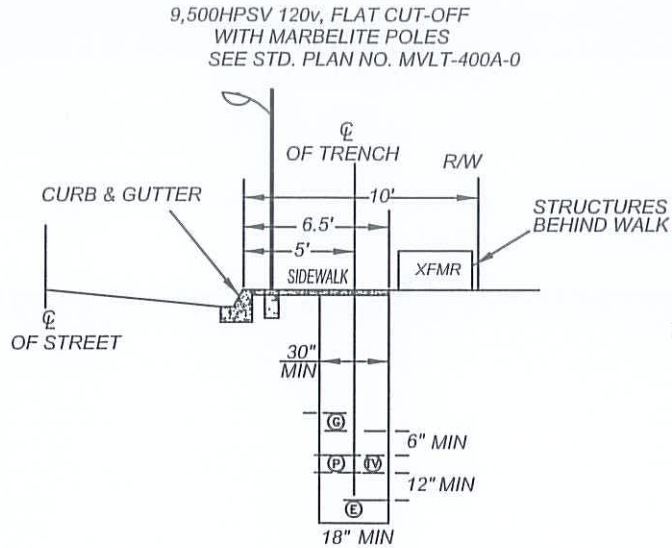


NOTE:
XFMR - TRANSFORMER
PMH - PAD MOUNT ENCLOSE

TRENCH DETAIL
RESIDENTIAL & COLLECTOR STREETS

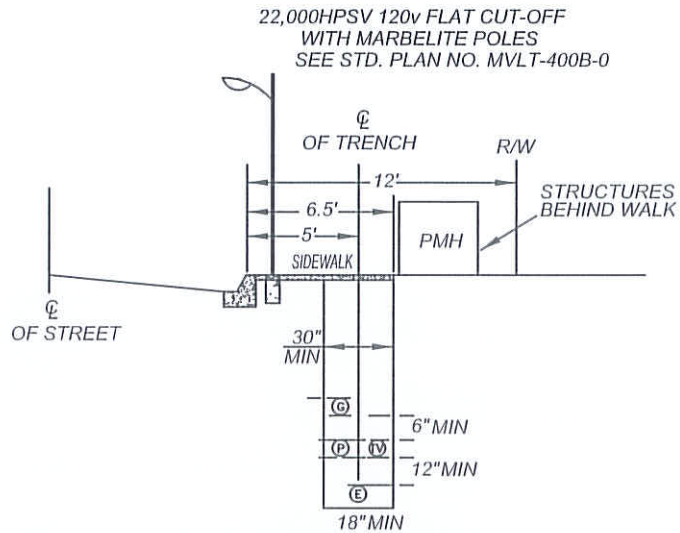

TRENCH DETAIL
ARTERIAL STREET

NOT TO SCALE



RECOMMENDED:

[Signature] H-5-14
DIVISION MANAGER DATE

APPROVED:

[Signature] 1/29/14
PUBLIC WORKS DIRECTOR / DATE
CITY ENGINEER

CITY OF MORENO VALLEY
PUBLIC WORKS DEPARTMENT - ELECTRIC UTILITY DIVISION

DRY UTILITIES TRENCH
SECTION

STANDARD PLAN

MVEU-709-0

SHEET 1 OF 1